


NOTES:


1. ALL HDPE LINERS AND GEONET TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
2. ALL BACK FILL TO BE COMPACTED IN LOOSE LIFTS NO GREATER THAN SIX (6") INCH TO MINIMUM 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D1557. (IN GENERAL THE DENSITY SO OBTAINED WILL BE HIGHER THAN THE 95% MAXIMUM DRY DENSITY ESTABLISHED BASED ON ASTM D698).
3. PENETRATION OF LINERS BY PIPES SHALL BE SEALED WITH STANDARD MANUFACTURER'S BOOT STRAPPED TO PIPES AND WELDED TO LINER (SUPPLIED BY MANUFACTURER)
4. THIS DRAWING IS CONCEPTUAL ONLY AND DOES NOT REPRESENT THE FINAL CONSTRUCTION DRAWING.

BRINE POND PLAN

NTS

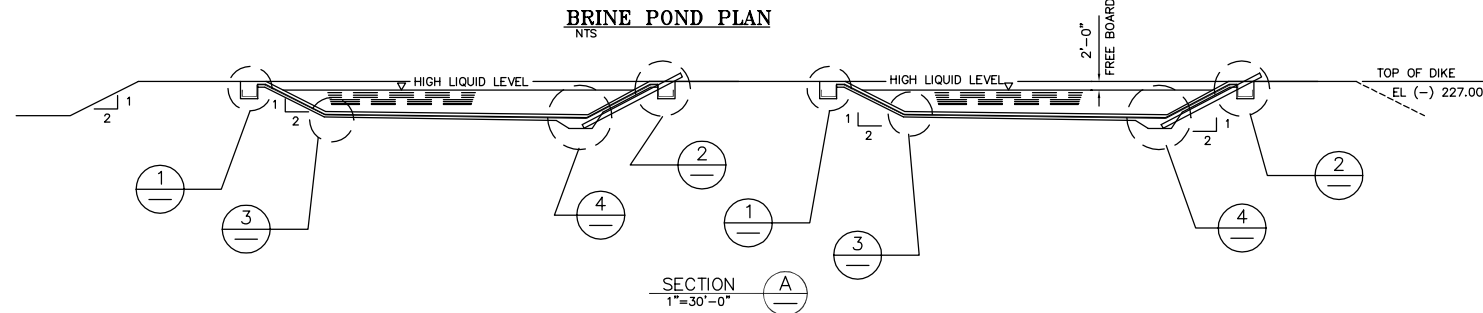

SECTION A-A
1"=30'-0"

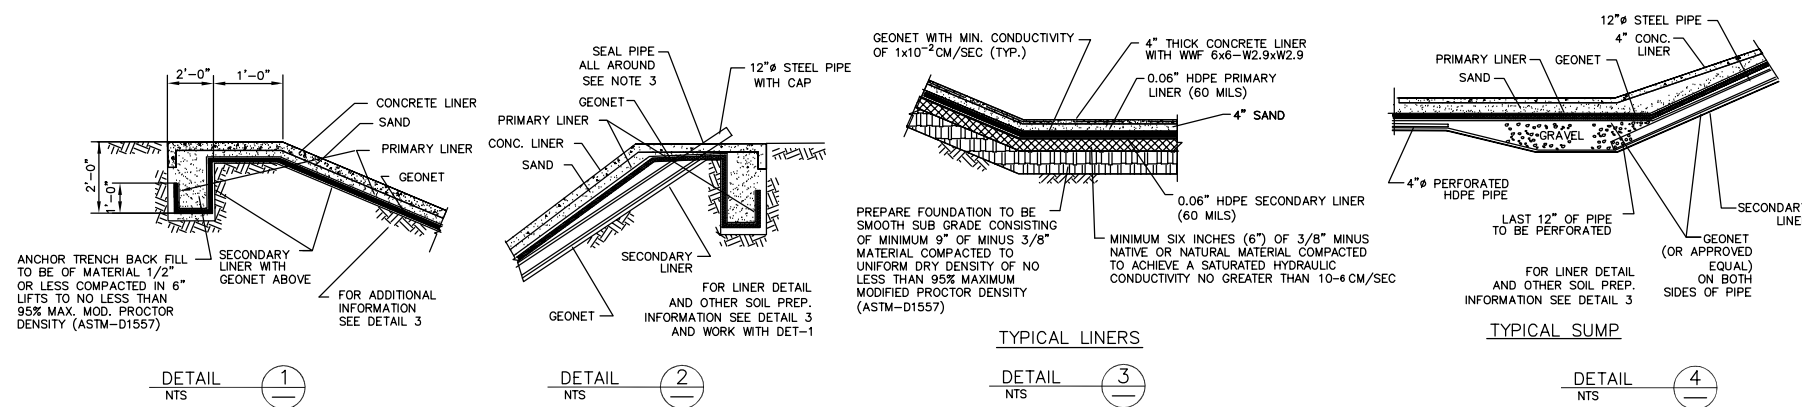

TYPICAL LINERS

DETAIL 3
NTS

TYPICAL SUMP

DETAIL 4
NTS



**SALTON SEA
UNIT 6**



**FIGURE 3.3-7
BRINE POND PLAN,
SECTION & DETAIL**

DESIGNED	by	date	SHEET
DRAWN			of
CHECKED			DRAWING NUMBER
APPROVED			21-043-SD-002

REV.	DESCRIPTION	int	int	date
		PREP	CHK	DATE